



National SARS-CoV-2 Wastewater Surveillance Programme

Week 49 2021 (05/12/2021—11/12/2021)

Report prepared on 15/12/2021

Background

People with COVID-19/SARS-CoV-2 infection can shed the virus in their stool, which can then be detected in wastewater, making environmental surveillance of wastewater a feasible means to monitor the circulation of SARS-CoV-2, the virus that causes COVID-19 disease, in the population.

The National SARS-CoV-2 Wastewater Surveillance Programme (NWSP) has been established through a partnership with Irish Water, the National Virus Reference Laboratory (NVRL), University College Dublin (UCD), the HSE Health Protection Surveillance Centre (HPSC) and Health Intelligence Unit (HIU). Samples from 68 wastewater catchment areas across Ireland are taken on a weekly basis and analysed for the presence of SARS-CoV-2. The wastewater catchment area of Ringsend in Dublin is sampled twice a week given the size of the population it captures. These 68 wastewater catchment areas (see Figure 2) cover 80% of the population connected to public wastewater treatment facilities.

The NWSP is an additional tool in Ireland's response to COVID-19/ SARS-CoV-2. The NWSP aims to complement our case-based surveillance systems (i.e. monitoring the number of people testing positive or presenting to a healthcare provider with symptoms) through acting as an early warning system for the circulation, or an increase in the circulation, of SARS-CoV-2 in a wastewater catchment area.

Please note that stool or wastewater are not recognised sources of transmission for SARS-CoV-2. Standard hygiene measures should be used after using the toilet. [Guidance from the WHO](#) for water and sanitation providers recommends standard best practices, including PPE for those working in proximity to wastewater, be followed.

Summary of results from week 49, 2021

In week 49¹, 2021 SARS-CoV-2 was detected in wastewater samples from the 57 wastewater catchment areas analysed (n=57). These results are in keeping with the high incidence rate of COVID-19 currently being seen throughout Ireland.

Please read 'Data uses' and 'Data limitations and uncertainties' in the technical notes prior to making any interpretation of the data.

¹ Dates of epidemiological weeks are available in the technical notes and at: <https://www.hpsc.ie/notifiablediseases/resources/epidemiologicalweeks/>

Overview of SARS-CoV-2 detection in wastewater in Ireland

Results are presented as the numerical value of the concentration of SARS-CoV-2 in the wastewater sample and as a descriptive category. The descriptive categories used are ‘positive’ when SARS-CoV-2 RNA was detected and could be quantified; ‘weak positive’ when SARS-CoV-2 RNA was detected but was below the quantification limit (BQL); ‘undetected’ when the numerical value was below the detection limit (BDL); and ‘unavailable’ if a result was not available because either a sample was not received or could not be fully analysed e.g. if flow data were not available. Please see the glossary and technical notes for further explanations.

In week 49, 2021, 58 samples were received and analysed for 57 wastewater catchment areas (Ringsend catchment area served by Ringsend wastewater treatment plant is sampled twice a week). Due to Storm Barra, samples were not received from 10 wastewater catchment areas. Youghal data is under validation and not presented. SARS-CoV-2 RNA was detected in samples from all 57 wastewater catchment areas tested. Of the 57 catchments for which a change in the past two weeks could be calculated, the level (gc/day) of SARS-CoV-2 in wastewater increased in 40 of them. Of these, 37 had an increase from 10 to 50%, and 3 had an increase of more than 50%. Ten remained stable and seven showed a decrease (See Figure 2).

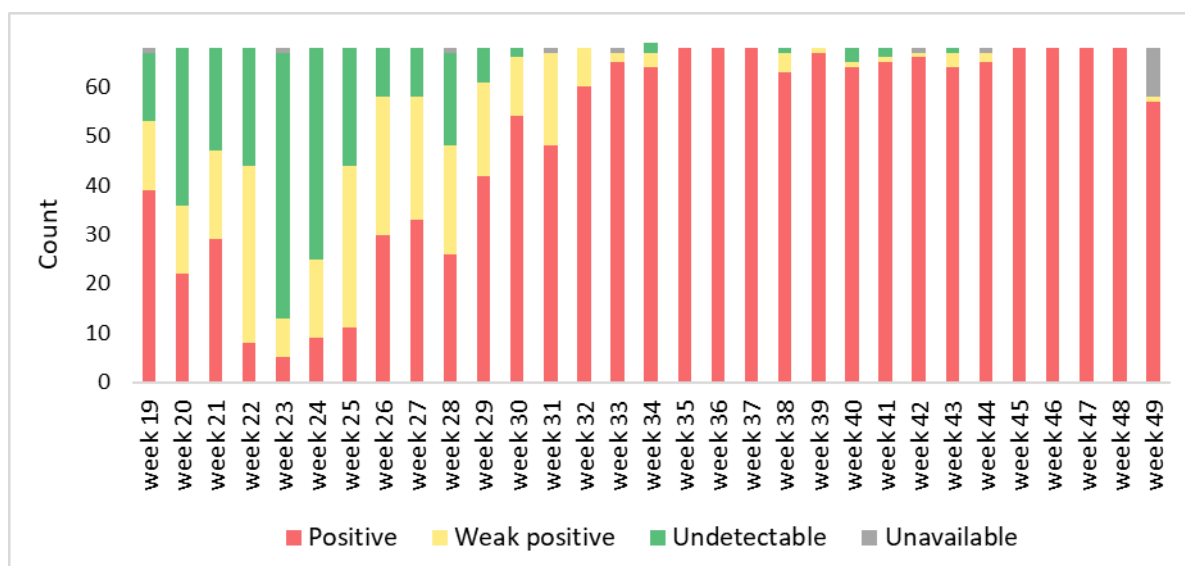


Figure 1. SARS-CoV-2 detection categories in Ireland by week, NWSP, weeks 19—49, 2021

**Samples with an undetected result may have SARS-CoV-2 present but the amount was too low to be detected by the test. It does not mean that SARS-CoV-2 is not circulating in the wastewater catchment area of the Wastewater treatment plant (WWTP).*

Table 1 and Figures 1 and 2 summarise the results from wastewater samples taken during week 49. Table 2a summarises the results by category for each wastewater catchment area during weeks 19—49, 2021 for all NWSP catchment areas except Ringsend. Results for the Ringsend catchment area is summarised separately in Table 2b as samples are taken at Ringsend biweekly.

Figure 3 summarises the SARS-CoV-2 RNA levels and 3 week moving average of those levels by wastewater catchment area each week since the start of the NWSP in week 19. Figure 4 focuses on data from the last 8 weeks.

Please note that wastewater data from different wastewater catchment areas should not be directly compared. All data are subject to ongoing validation.

Table 1. National Wastewater Surveillance Programme sampling results by wastewater catchment area, week 49, 2021

County	Wastewater catchment area	Sample type	Sample date	Result category^
Carlow	Carlow	Complete (composite)	07/12/2021	Positive*
	Tullow	Unknown	07/12/2021	Positive*
Cavan	Cavan	Complete (composite)	06/12/2021	Positive*
	Virginia	Complete (composite)	06/12/2021	Positive
Clare	Ennis North	Complete (composite)	05/12/2021	Positive
	Shannon	Complete (composite)	05/12/2021	Positive
Cor	Ballincollig			No sample/not analysed
	Clonakilty			No sample/not analysed
	Cork City			No sample/not analysed
	Cork Lower Harbour			No sample/not analysed
	Fermoy	Complete (composite)	06/12/2021	Positive*
	Mallow			No sample/not analysed
	Midleton			No sample/not analysed
Donegal	Buncrana	Incomplete (composite)	07/12/2021	Positive
	Letterkenny	Complete (composite)	07/12/2021	Positive
Dublin	Balbriggan	Complete (composite)	06/12/2021	Positive
	Malahide	Grab	06/12/2021	Positive
	Portrane Donabate	Complete (composite)	06/12/2021	Positive
	Ringsend	Complete (composite)	05/12/2021	Positive
	Ringsend	Complete (composite)	08/12/2021	Positive*
	Shanganagh	Complete (composite)	07/12/2021	Positive
	Swords	Complete (composite)	06/12/2021	Positive*
Galway	Galway	Complete (composite)	05/12/2021	Positive
	Tuam	Complete (composite)	05/12/2021	Positive
Kerry	Killarney			No sample/not analysed
	Tralee			No sample/not analysed
Kildare	Athy	Complete (composite)	07/12/2021	Positive
	Kildare	Unknown	07/12/2021	Positive
	Lower Liffey Valley Regional Sewerage Scheme (Leixlip)	Complete (composite)	07/12/2021	Positive
	Upper Liffey Valley Sewerage Scheme (Osberstown)	Complete (composite)	07/12/2021	Positive
Kilkenny	Kilkenny	Complete (composite)	05/12/2021	Positive
	Thomastown	Complete (composite)	05/12/2021	Positive
Laois	Portarlinton	Complete (composite)	05/12/2021	Positive
	Portlaoise	Complete (composite)	05/12/2021	Positive
Leitrim	Carrick on Shannon	Complete (composite)	07/12/2021	Positive
	Manorhamilton	Complete (composite)	07/12/2021	Weak positive
Limerick	Castletroy	Incomplete (composite)	06/12/2021	Positive
	Limerick City	Complete (composite)	06/12/2021	Positive
Longford	Edgeworthstown	Complete (composite)	07/12/2021	Positive*
	Longford	Complete (composite)	07/12/2021	Positive
Louth	Drogheda	Complete (composite)	06/12/2021	Positive
	Dundalk	Complete (composite)	06/12/2021	Positive
Mayo	Ballina	Complete (composite)	06/12/2021	Positive
	Castlebar	Complete (composite)	05/12/2021	Positive

Table 1(continued). National Wastewater Surveillance Programme sampling results by wastewater catchment area, week 49, 2021

County	Wastewater catchment area	Sample type	Sample date	Result category [^]
Meath	Navan	Grab	06/12/2021	Positive
	Trim	Complete (composite)	07/12/2021	Positive
Monaghan	Carrickmacross	Incomplete (composite)	06/12/2021	Positive
	Monaghan	Complete (composite)	06/12/2021	Positive
Offaly	Birr	Complete (composite)	05/12/2021	Positive
	Tullamore	Complete (composite)	05/12/2021	Positive
Roscommon	Monksland	Complete (composite)	06/12/2021	Positive
	Roscommon	Complete (composite)	06/12/2021	Positive
Sligo	Enniscrone	Complete (composite)	05/12/2021	Positive
	Sligo	Complete (composite)	07/12/2021	Positive
Tipperary	Clonmel	Complete (composite)	06/12/2021	Positive*
	Nenagh			No sample/not analysed
	Roscrea	Complete (composite)	06/12/2021	Positive*
	Thurles			No sample/not analysed
Waterford	Dungarvan	Complete (composite)	05/12/2021	Positive
	Tramore	Complete (composite)	05/12/2021	Positive
	Waterford	Complete (composite)	05/12/2021	Positive*
Westmeath	Athlone	Complete (composite)	05/12/2021	Positive
	Mullingar	Complete (composite)	07/12/2021	Positive
Wexford	Courtown Gorey	Complete (composite)	07/12/2021	Positive
	Enniscorthy	Complete (composite)	05/12/2021	Positive
	Wexford	Complete (composite)	05/12/2021	Positive
Wicklow	Greystones	Complete (composite)	07/12/2021	Positive
	Wicklow	Complete (composite)	07/12/2021	Positive

* Flow rate was not available at time of reporting, the average 2020 flow rate for the wastewater plant is used to calculate result.

** Samples with an 'undetectable' result may have SARS-CoV-2 present but the amount was too low to be detected by the test. It does not mean that SARS-CoV-2 is not circulating in the wastewater catchment area.

Table 2a. SARS-CoV-2 detections in wastewater samples by wastewater catchment area and week, NWSP, week 19 to week 49, 2021

County	Catchment area	Positive	Weak positive	Undetectable*	Unavailable	Dots indicate the result was obtained using average flow data																																	
		week 19	week 20	week 21	week 22	week 23	week 24	week 25	week 26	week 27	week 28	week 29	week 30	week 31	week 32	week 33	week 34	week 35	week 36	week 37	week 38	week 39	week 40	week 41	week 42	week 43	week 44	week 45	week 46	week 47	week 48	week 49							
Carlow	Carlow																																						
	Tullow																																						
Cavan	Cavan																																						
	Virginia																																						
Clare	Ennis North																																						
	Shannon																																						
Cork	Ballincollig																																						
	Clonakilty																																						
	Cork City																																						
	Cork Lower Harbour																																						
	Fermoy																																						
	Mallow																																						
	Midleton																																						
Donegal	Buncrana																																						
	Letterkenny																																						
Dublin	Balbriggan																																						
	Malahide																																						
	Portrane Donabate																																						
	Shanganagh																																						
Galway	Galway																																						
	Tuam																																						
Kerry	Killarney																																						
	Tralee																																						
Kildare	Athy																																						
	Kildare																																						
	Lower Liffey Valley Regional Sewerage Scheme (Leixlip)																																						
	Upper Liffey Valley Sewerage Scheme (Osberstown)																																						
Kilkenny	Kilkenny																																						
	Thomastown																																						
Laois	Portarlinton																																						
	Portlaoise																																						
Leitrim	Carrick on Shannon																																						
	Manorhamilton																																						
Limerick	Castletroy																																						
	Limerick City																																						
Longford	Edgeworthstown																																						
Louth	Drogheda																																						
	Dundalk																																						
Mayo	Ballina																																						
	Castlebar																																						
Meath	Navan																																						
	Trim																																						
Monaghan	Carrickmacross																																						
	Monaghan																																						
Offaly	Birr																																						
	Tullamore																																						
Roscommon	Monksland																																						
	Roscommon																																						
Sligo	Enniscrone																																						
	Sligo																																						
Tipperary	Clonmel																																						
	Nenagh																																						
	Roscrea																																						
	Thurles																																						
Waterford	Dungarvan																																						
	Tramore																																						
	Waterford																																						
Westmeath	Athlone																																						
	Mullingar																																						
Wexford	Courtown Gorey																																						
	Enniscorthy																																						
	Wexford																																						
Wicklow	Greystones																																						
	Wicklow																																						


Table 2b. Biweekly results for SARS-CoV-2 detections in the Ringsend WWTP, week 19 to week 49, 2021

Week	Specimen date	Result category	Result category**
19	09/05/2021		Positive
	12/05/2021		Positive
20	16/05/2021		Positive
	19/05/2021		Positive
21	23/05/2021		Weak positive
	26/05/2021		Undetectable
22	30/05/2021		Weak positive
	02/06/2021		Weak positive
23	07/06/2021		Weak positive
	09/06/2021		Undetectable
24	13/06/2021		Undetectable
	16/06/2021		Undetectable
25	20/06/2021		Weak positive
	23/06/2021		Weak positive
26	27/06/2021		Positive
	30/06/2021		Positive
27	04/07/2021		Positive
	07/07/2021		Positive
28	11/07/2021		Positive
	14/07/2021		Weak positive
29	18/07/2021		Positive
	21/07/2021		Weak positive
30	25/07/2021		Positive
	28/07/2021		Positive
31	01/08/2021		Weak positive
	04/08/2021		Weak positive
32	08/08/2021		Positive
	11/08/2021		Positive
33	15/08/2021		Positive
	18/08/2021		Positive
34	22/08/2021		Positive
	25/08/2021		Positive
35	29/08/2021		Positive
	01/09/2021		Positive
36	05/09/2021		Positive*
	08/09/2021		Positive*
37	12/09/2021		Positive
	15/09/2021		Positive
38	19/09/2021		Positive
	22/09/2021		Positive
39	26/09/2021		Positive
	29/09/2021		Positive
40	03/10/2021		Positive
	06/10/2021		Positive
41	10/10/2021		Positive*
	13/10/2021		Positive*
42	17/10/2021		Positive*
	20/10/2021		Positive*
43	24/10/2021		Weak positive*
	27/10/2021		Positive*
44	31/10/2021		Positive*
	03/11/2021		Positive*
45	07/11/2021		Positive*
	10/11/2021		Positive*
46	14/11/2021		Positive*
	17/11/2021		Positive*
47	21/11/2021		Positive*
	24/11/2021		Positive*
48	28/11/2021		Positive*
	01/12/2021		Positive*
49	05/12/2021		Positive
	08/12/2021		Positive*

* Flow rate was not available at time of reporting, the average 2020 flow rate for the wastewater plant is used to calculate result.

**Samples with an 'undetectable' result may have SARS-CoV-2 present but the amount was too low to be detected by the test. It does not mean that SARS-CoV-2 is not circulating in the wastewater catchment area.

Figure 2. Map showing the approximate location of wastewater catchment areas and results for SARS-CoV-2 detections during week 49. Results are shown as percentage change in SARS-CoV-2 RNA (gc/day)[§] between week 48 and week 49 and whether this change is increasing, decreasing or steady[^].

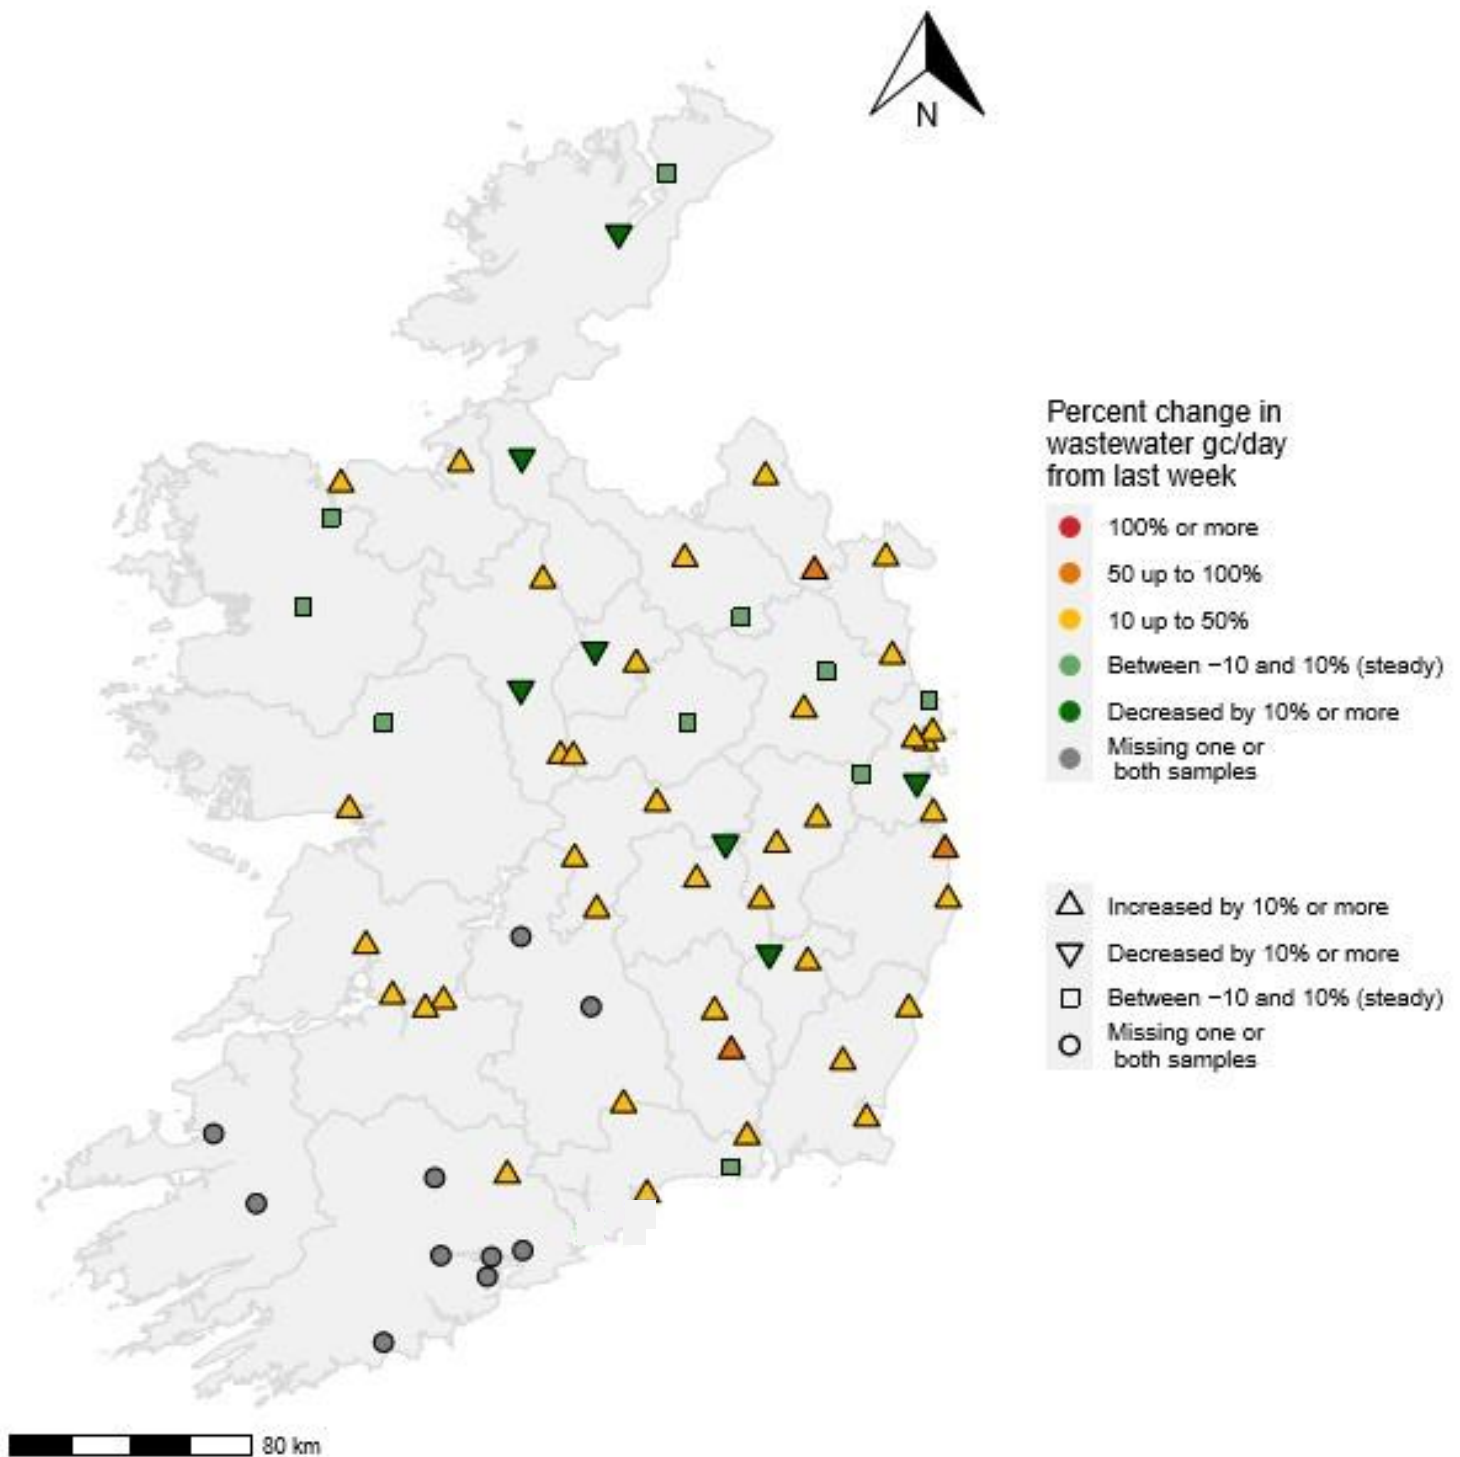

[^]Wastewater catchment areas where the percentage difference in gc/day has increased or decreased by less than 10% between the current and previous weeks are considered to be steady.

[§]Viral load values based on GAM-smoothed estimates. See technical notes.

Figure 3. SARS-CoV-2 concentration by wastewater catchment area by week (grey connected line), and 3 week moving average (maroon line), NWSP, weeks 19–49, 2021

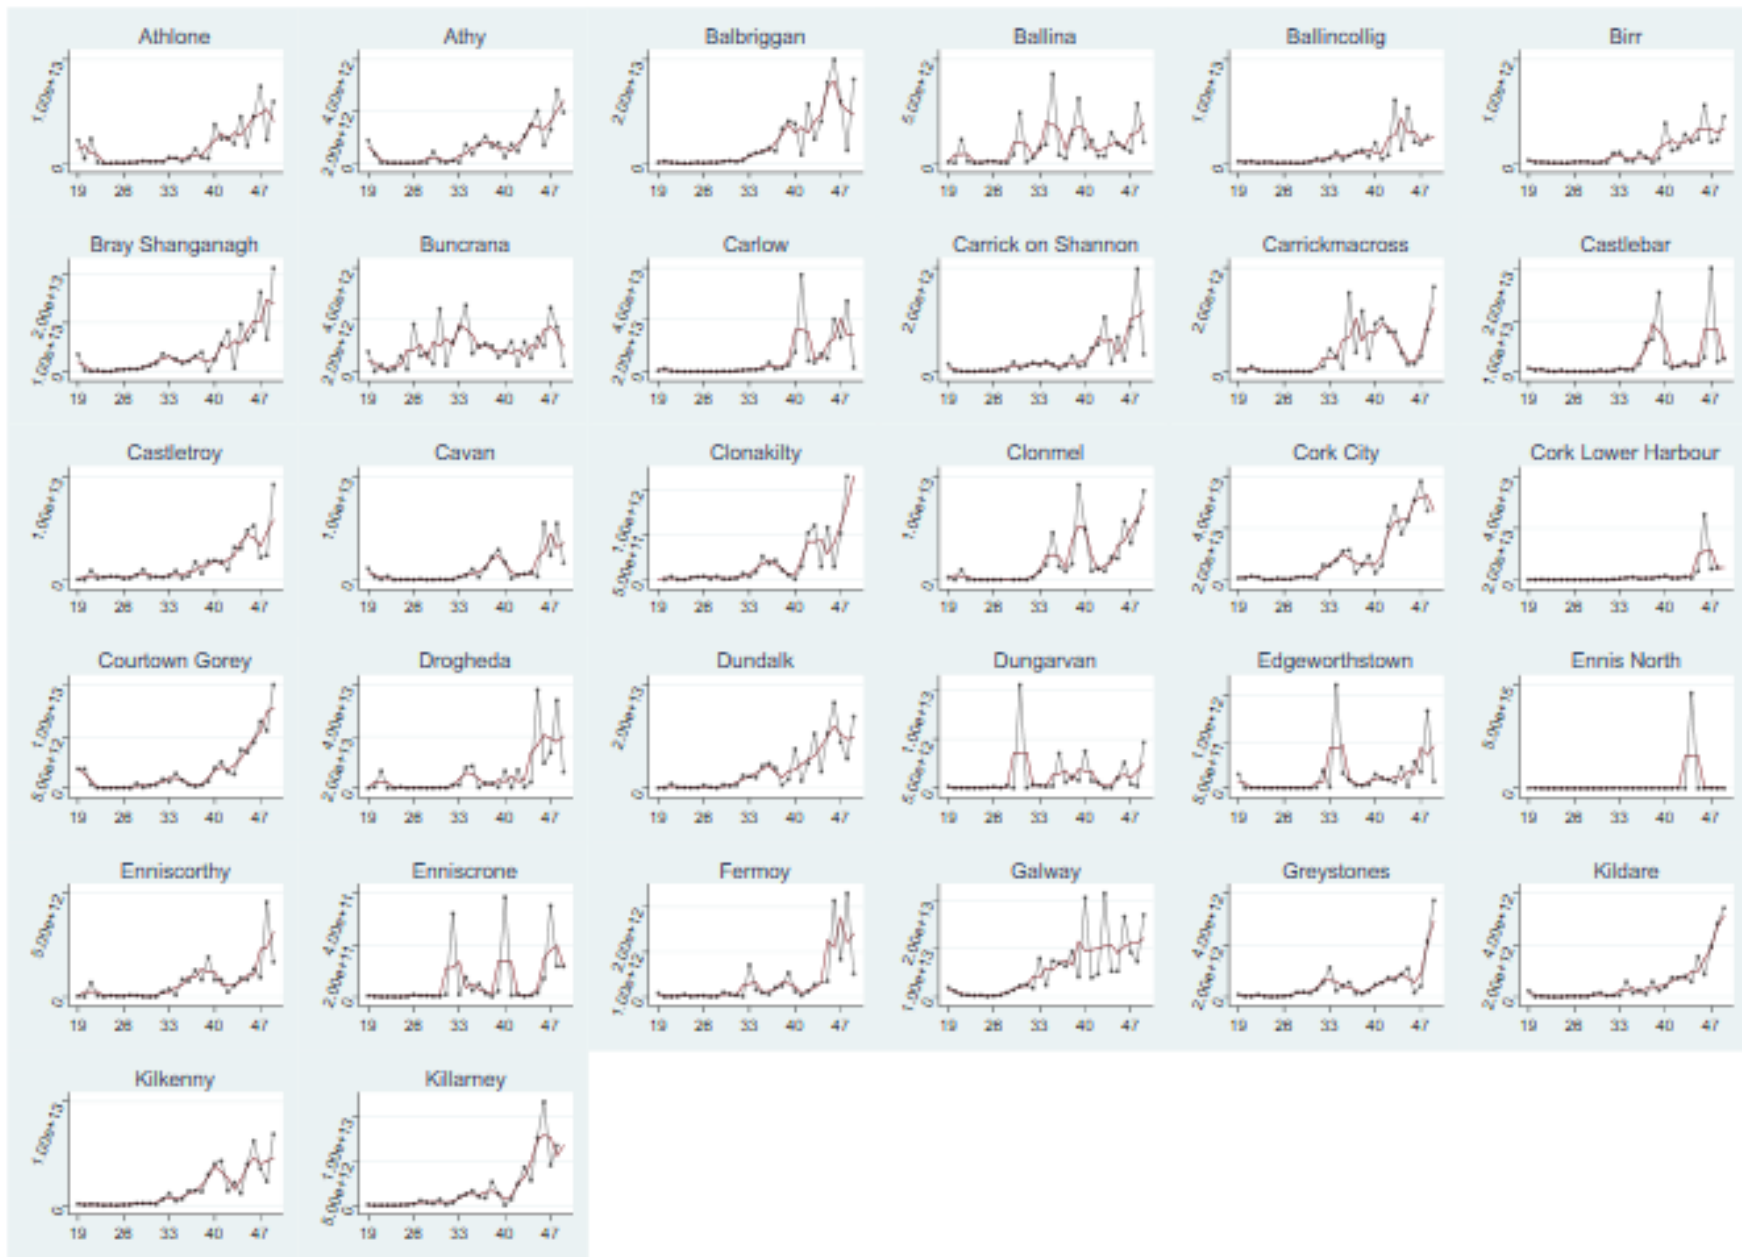


Figure 3 (continued). SARS-CoV-2 concentration by wastewater catchment area by week (grey connected line), and 3 week moving average (maroon line), NWSP, weeks 19–49, 2021

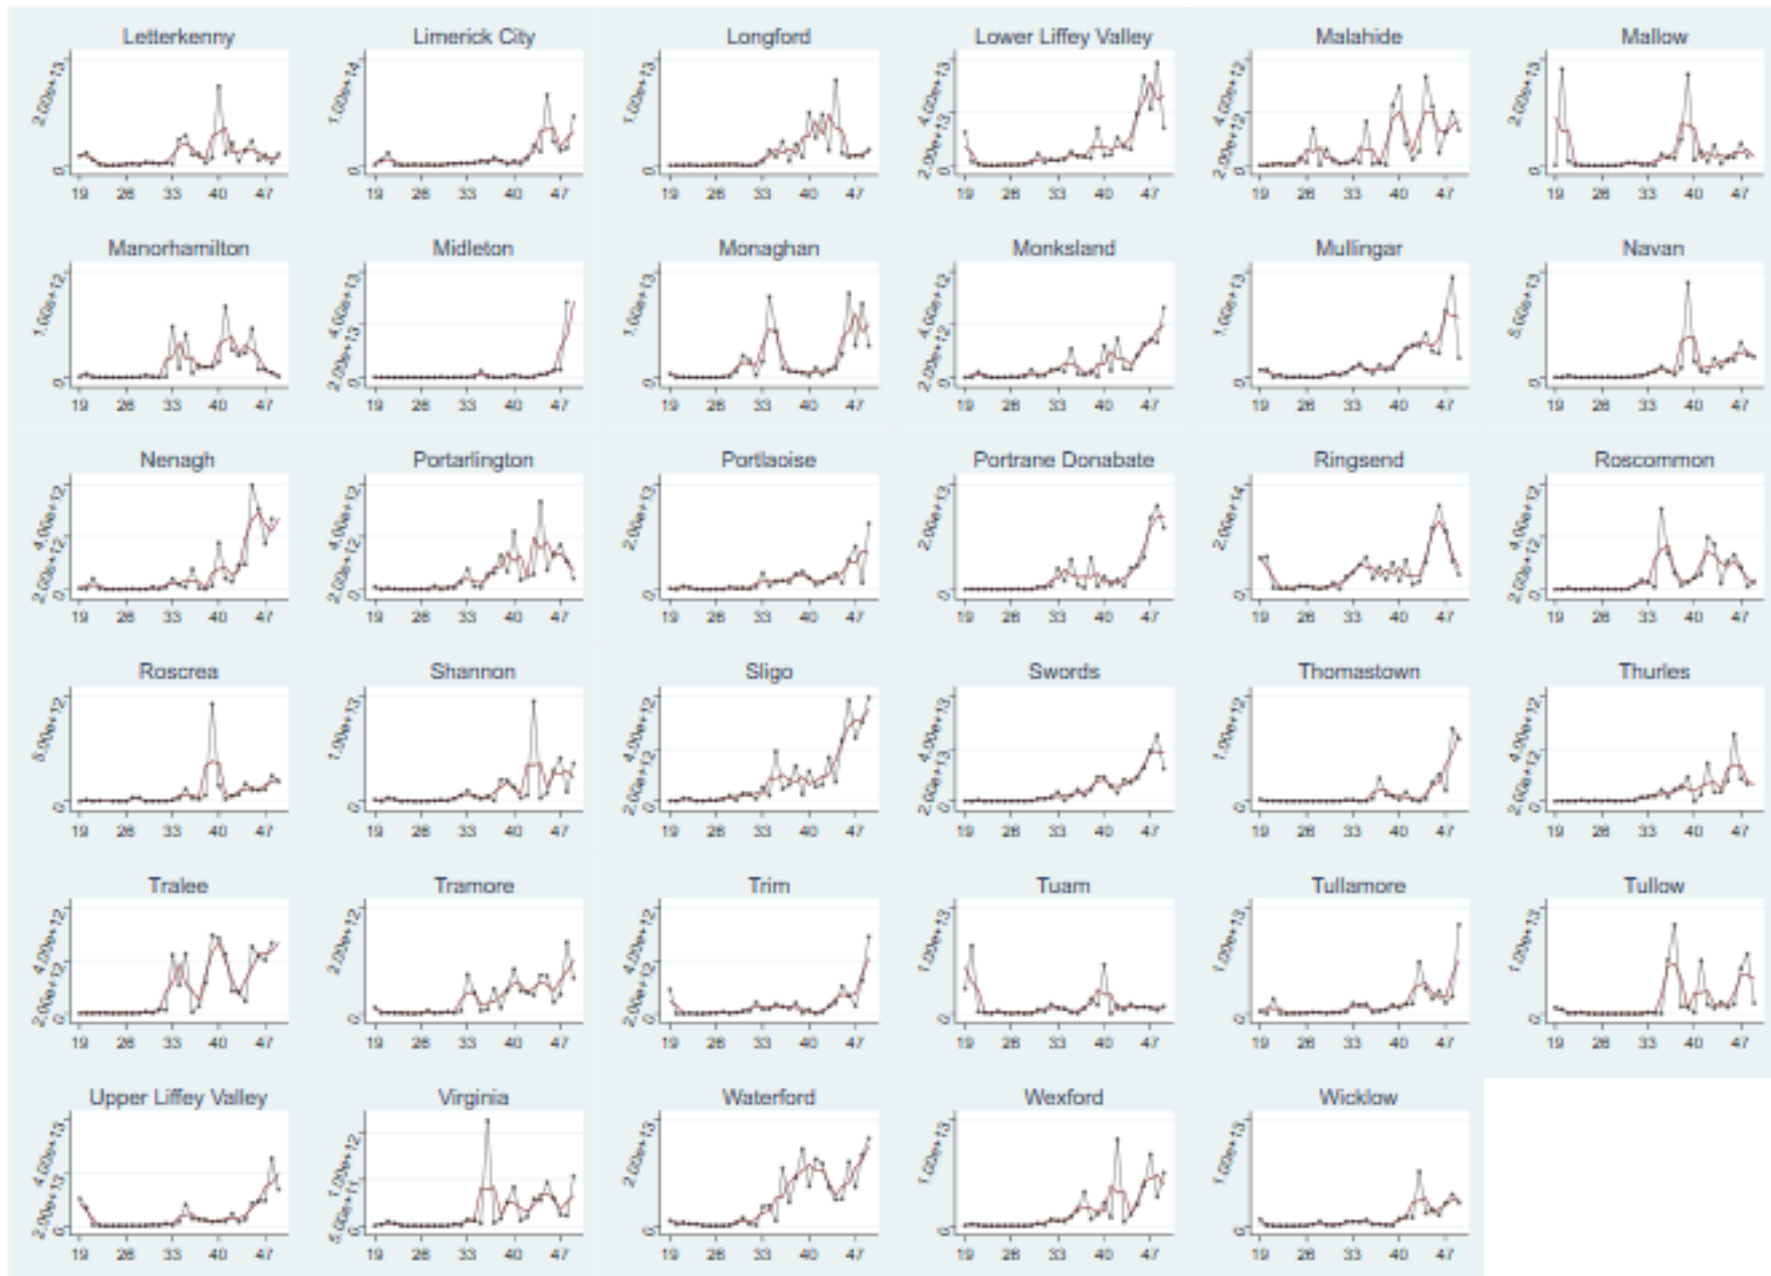


Figure 4. SARS-CoV-2 concentration by wastewater catchment area by week (grey connected line), and 3 week moving average (maroon line), NWSP, weeks 42—49, 2021

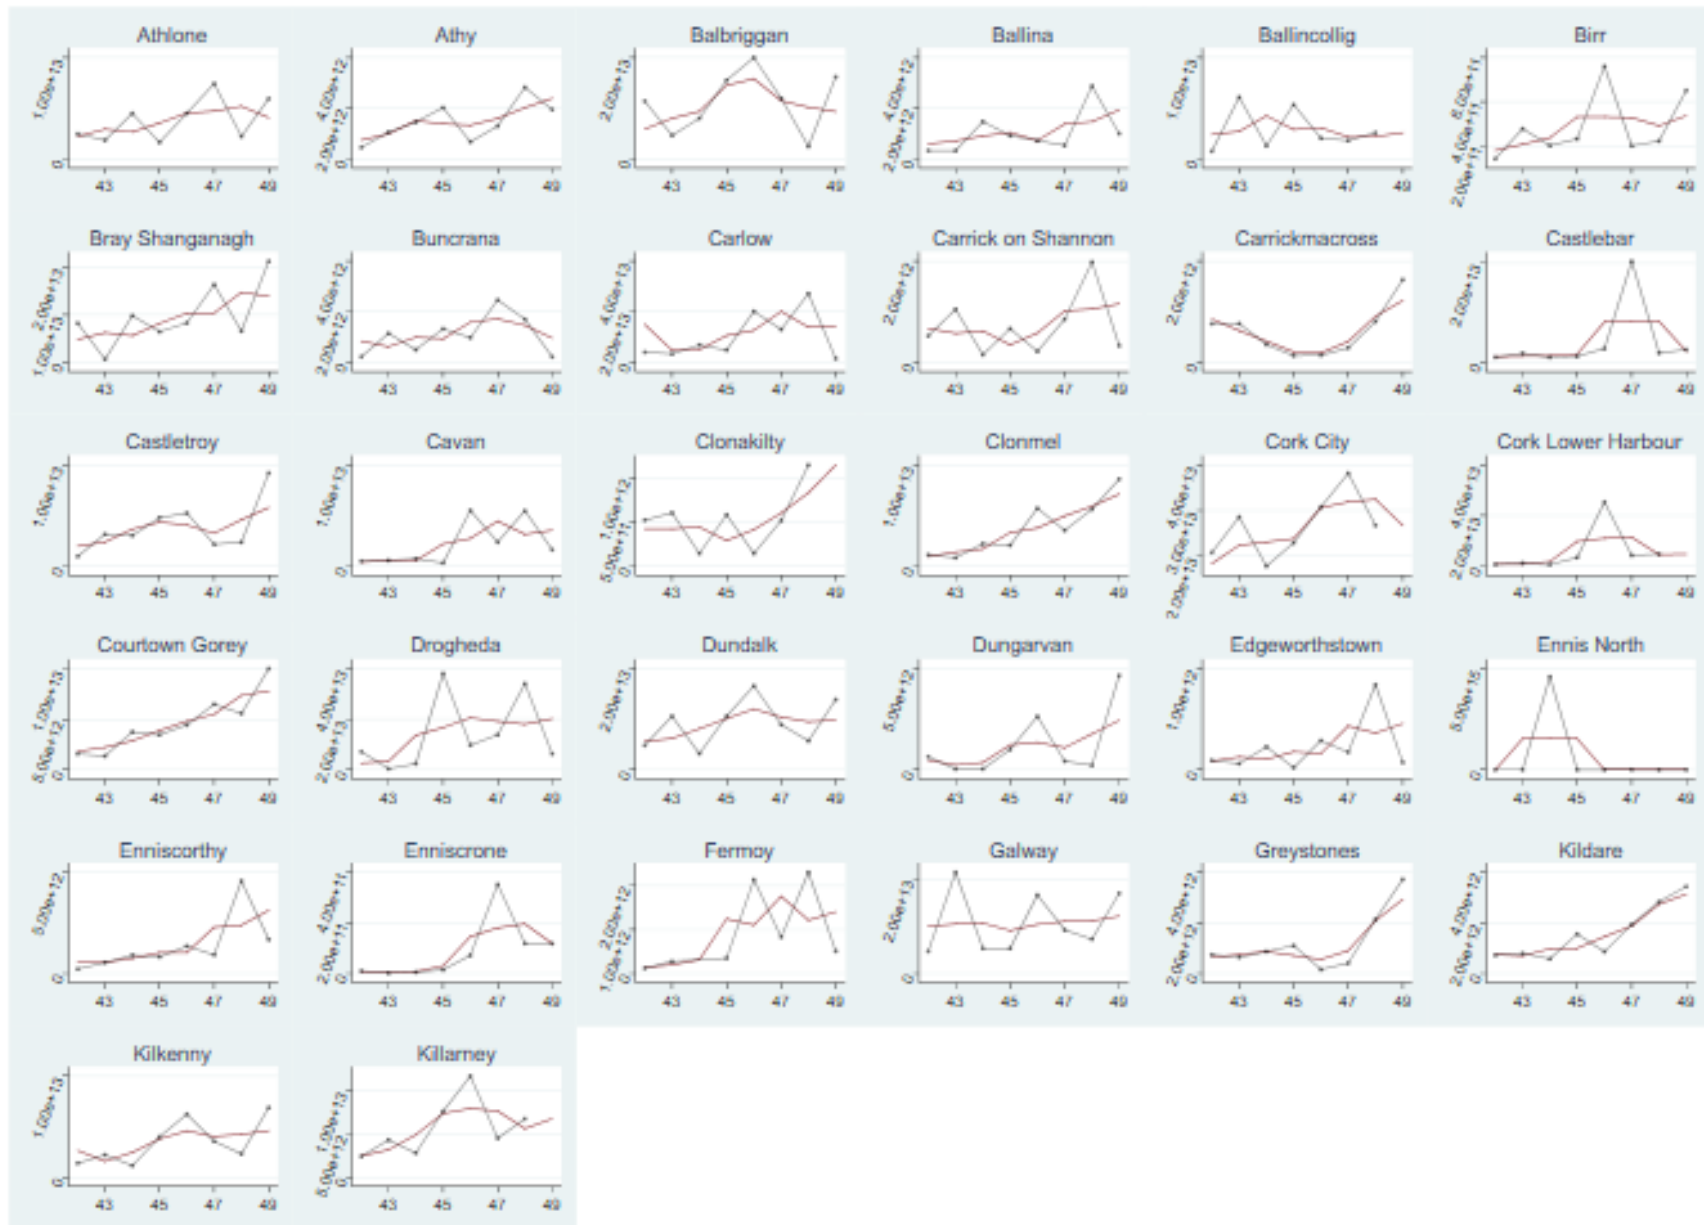


Figure 4 (continued). SARS-CoV-2 concentration by wastewater catchment area by week (grey connected line), and 3 week moving average (maroon line), NWSP, weeks 42—49, 2021

